




A Road Map for Sewer Rehab *

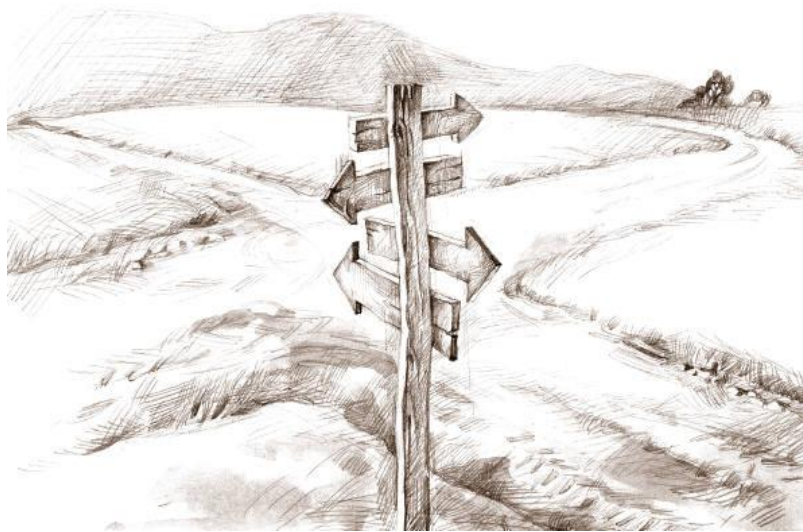

A ten-step strategic plan

PRESENTED BY

George Kurz, P.E., DEE

George.kurz@comcast.net

** A significant portion of this work was conducted with CTE-AECOM as part of the Nashville Overflow Abatement Program 1991-2005*

?

?

?

?

Do we ***REALLY*** have an I/I Problem?

IS SEWER REHABILITATION EFFECTIVE ?

WHAT LEVEL OF REDUCTION DO

? WE REASONABLY EXPECT ?

HOW DO WE ACHIEVE SUCCESS ?

?

?

?

?

I/I Indicator:

BOD Influent CONCENTRATION

TYPICAL TREATMENT PLANT Influent:

“Weak” **100 – 150 mg/l**


“Medium” **150 – 200 mg/l**

“Strong” **200 - 250 mg/l**


Strength of Domestic Sewage:

~ 350 mg/l


Average Municipal BOD Influent Concentrations in 233 Tennessee MORs (mg/l)

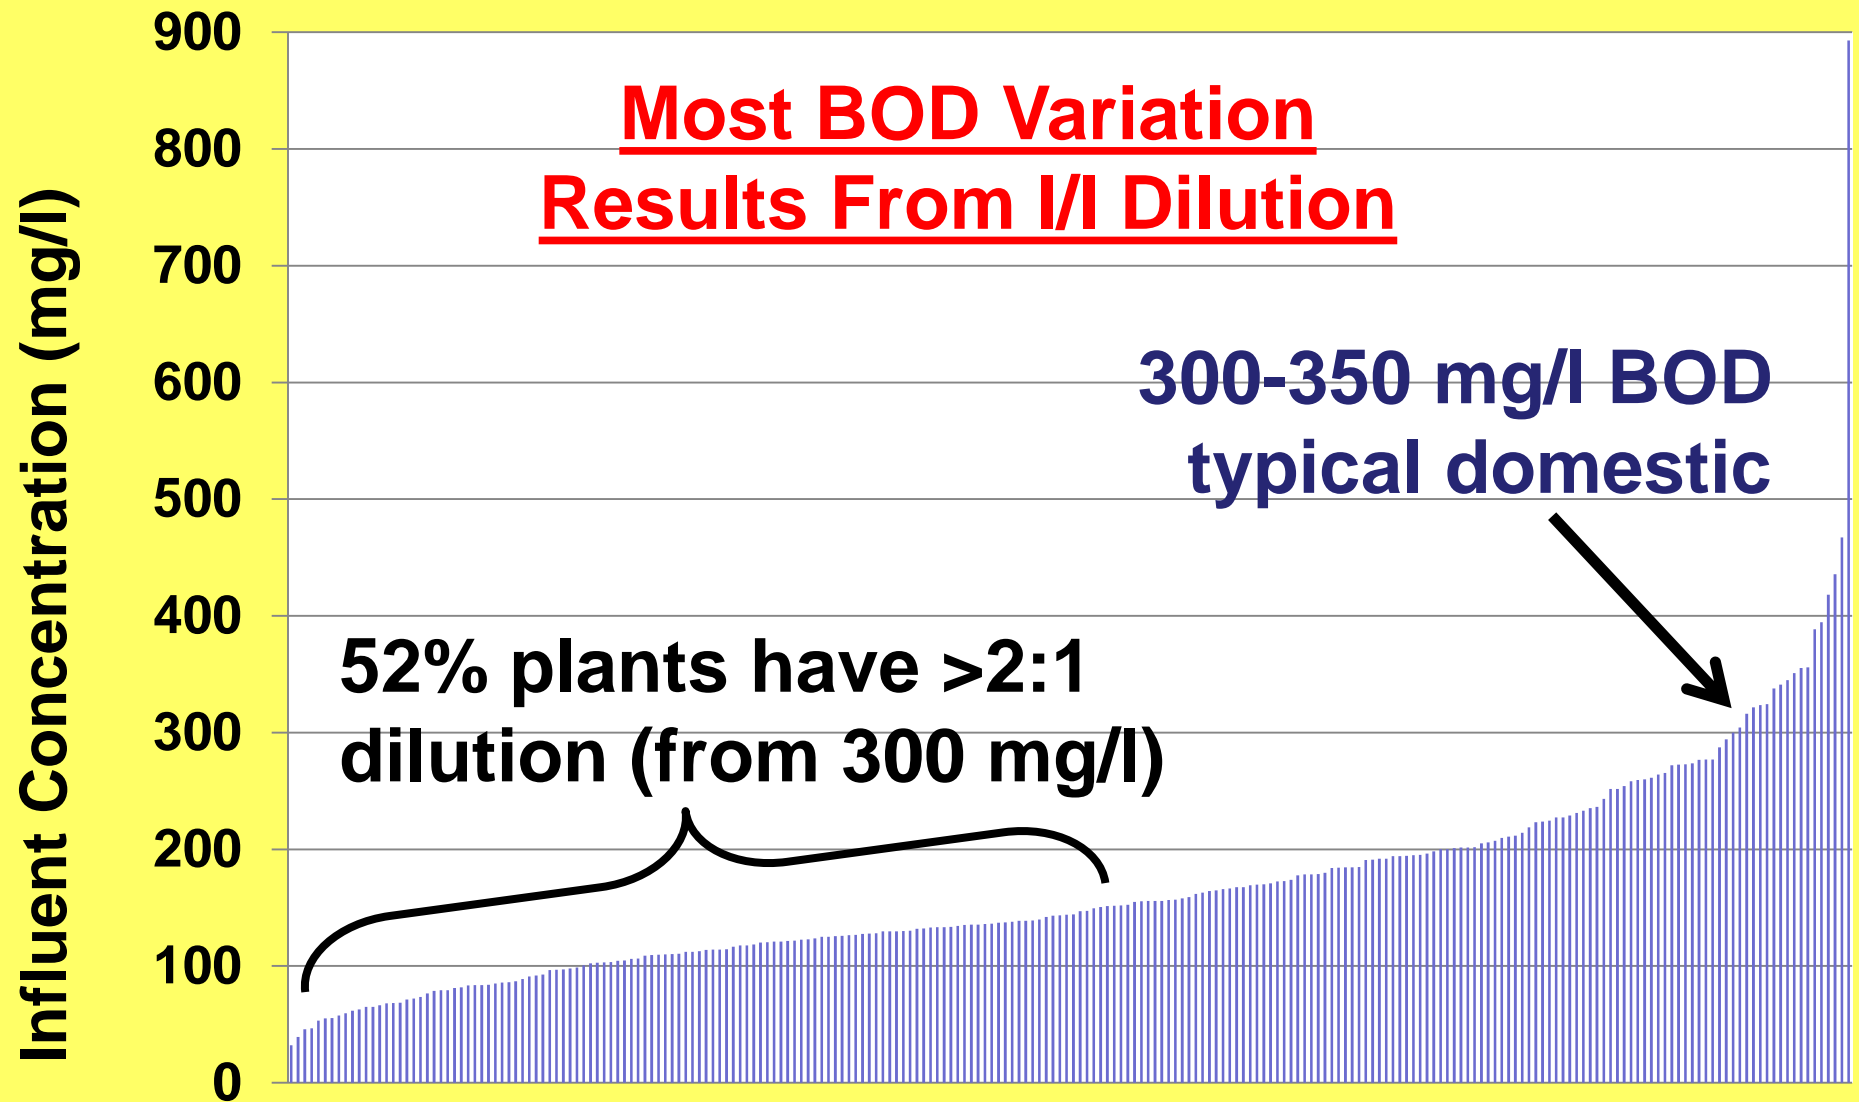

Annual % I/I in 243 POTW's Influent

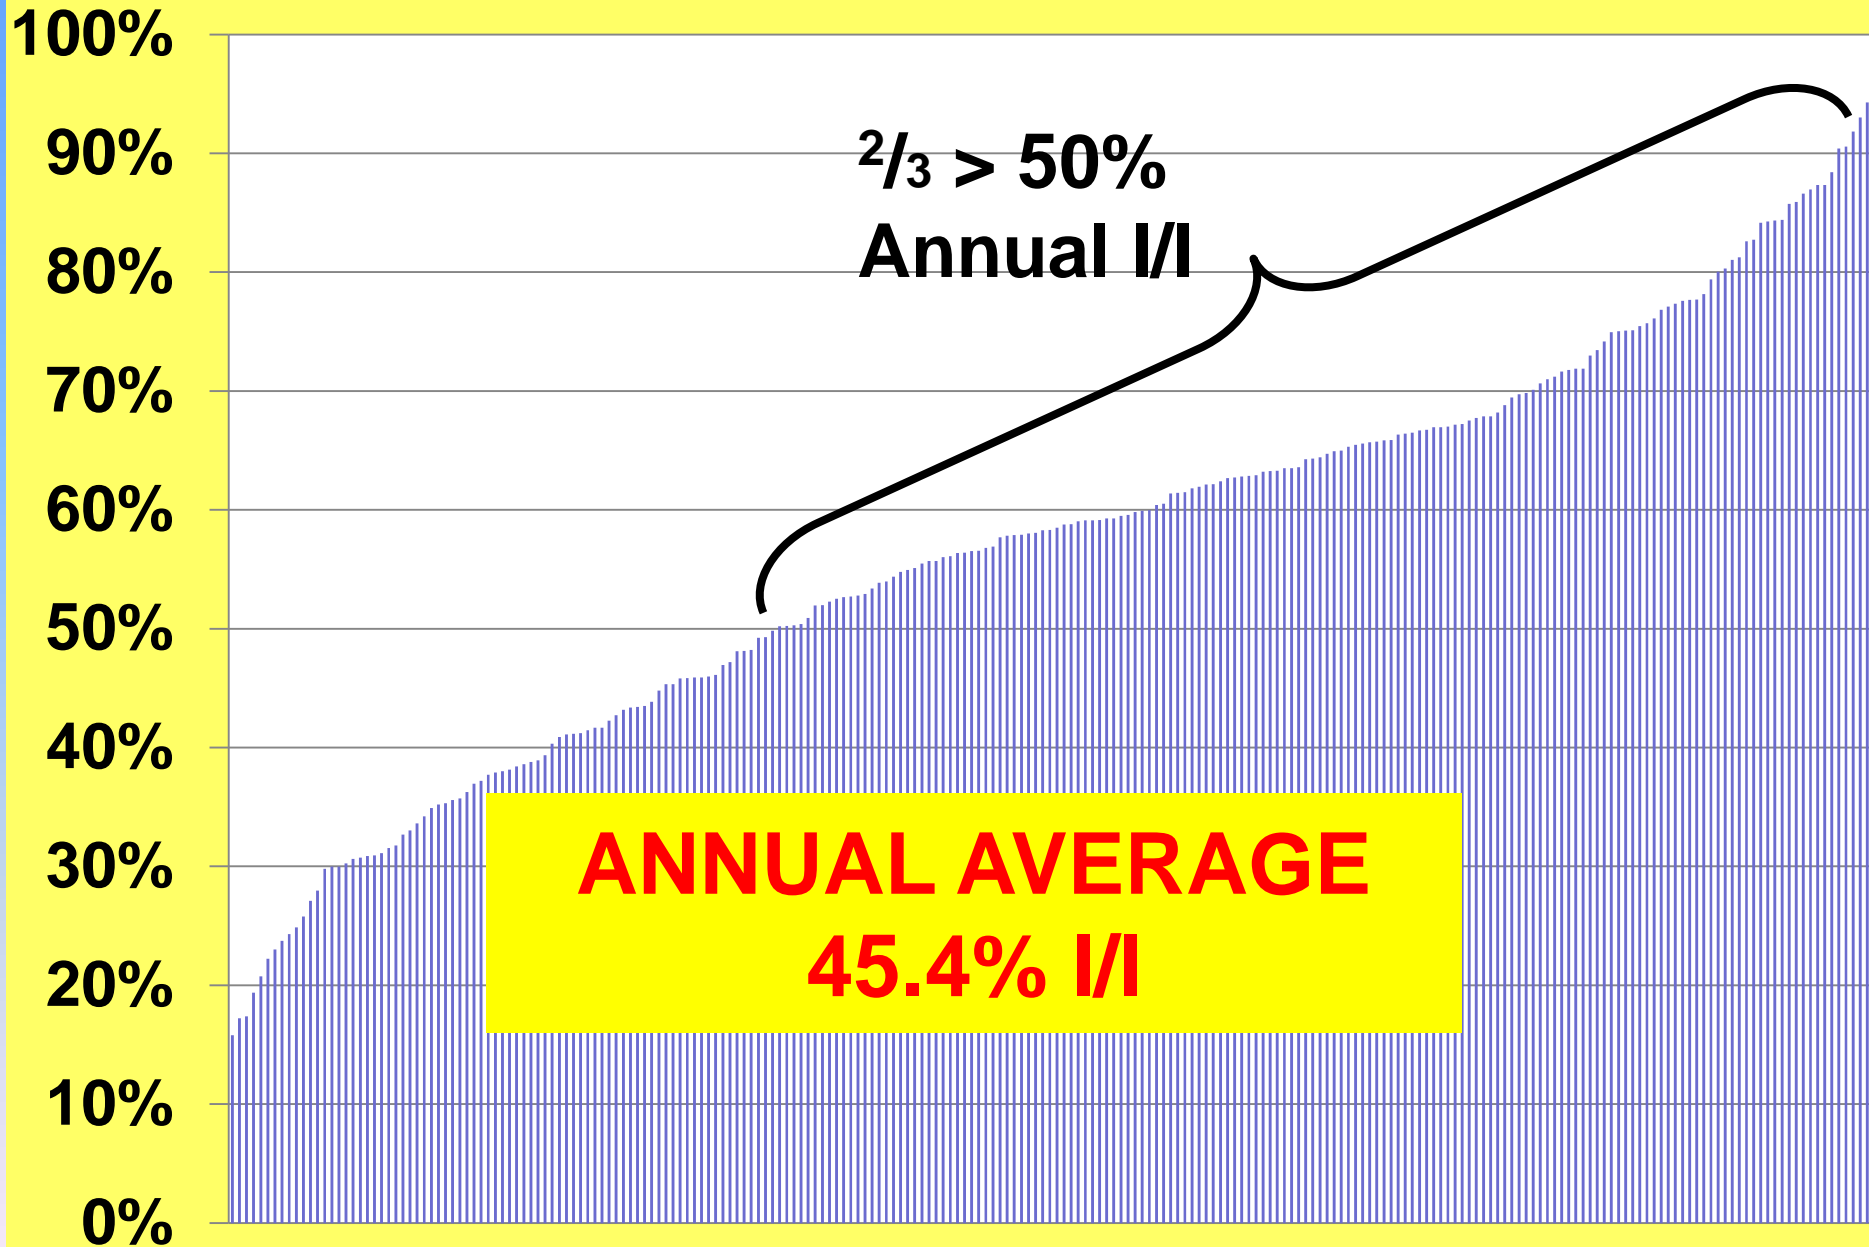

So, what approach do you use to achieve I/I reduction?

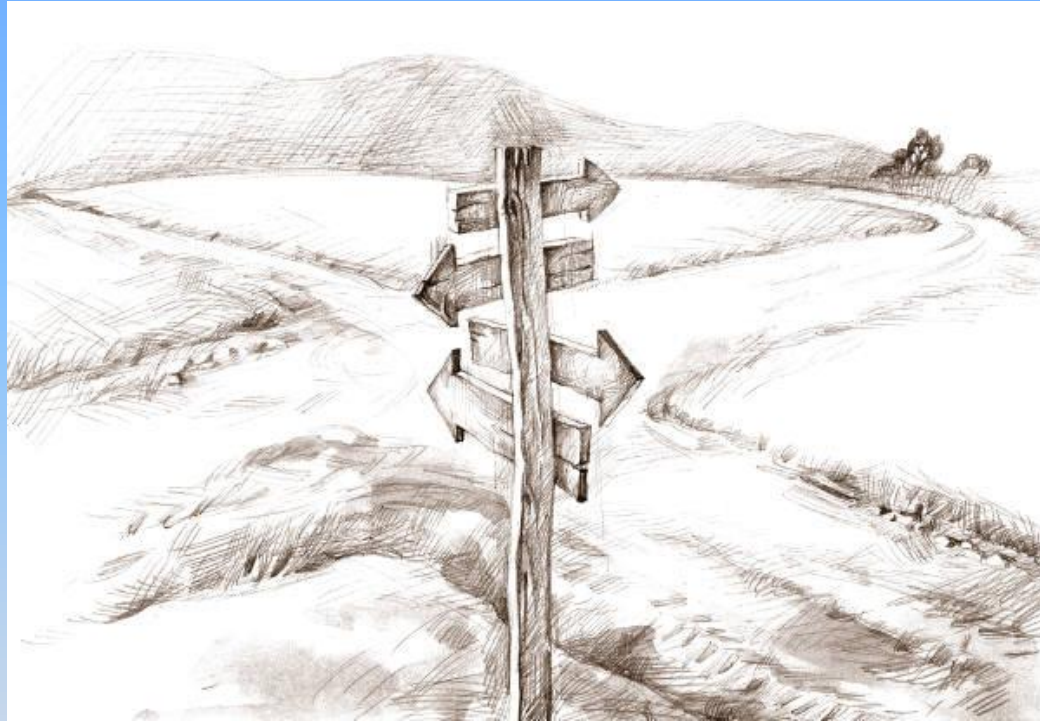


All roads look relatively equal if there is no track record of success.

Successful Sewer Rehab Strategy:

- Based on **actual field results** in Nashville & Brentwood
- **Largest published database** for measured I/I reduction in the US
- Analyzed **126 miles of rehabilitation** (282 miles total - ~ 11% system)
- **I/I cut in half**
- **123 overflows eliminated**
- EPA commends **stream improvements**


REHABILITATION EFFECTIVENESS & Measured I/I Reduction

BRT P.S. Annual I/I for Progressive 365-day periods
Oct 2014, ~851 MG reduction - 50% [base flow 2014, BRT rain gauge]

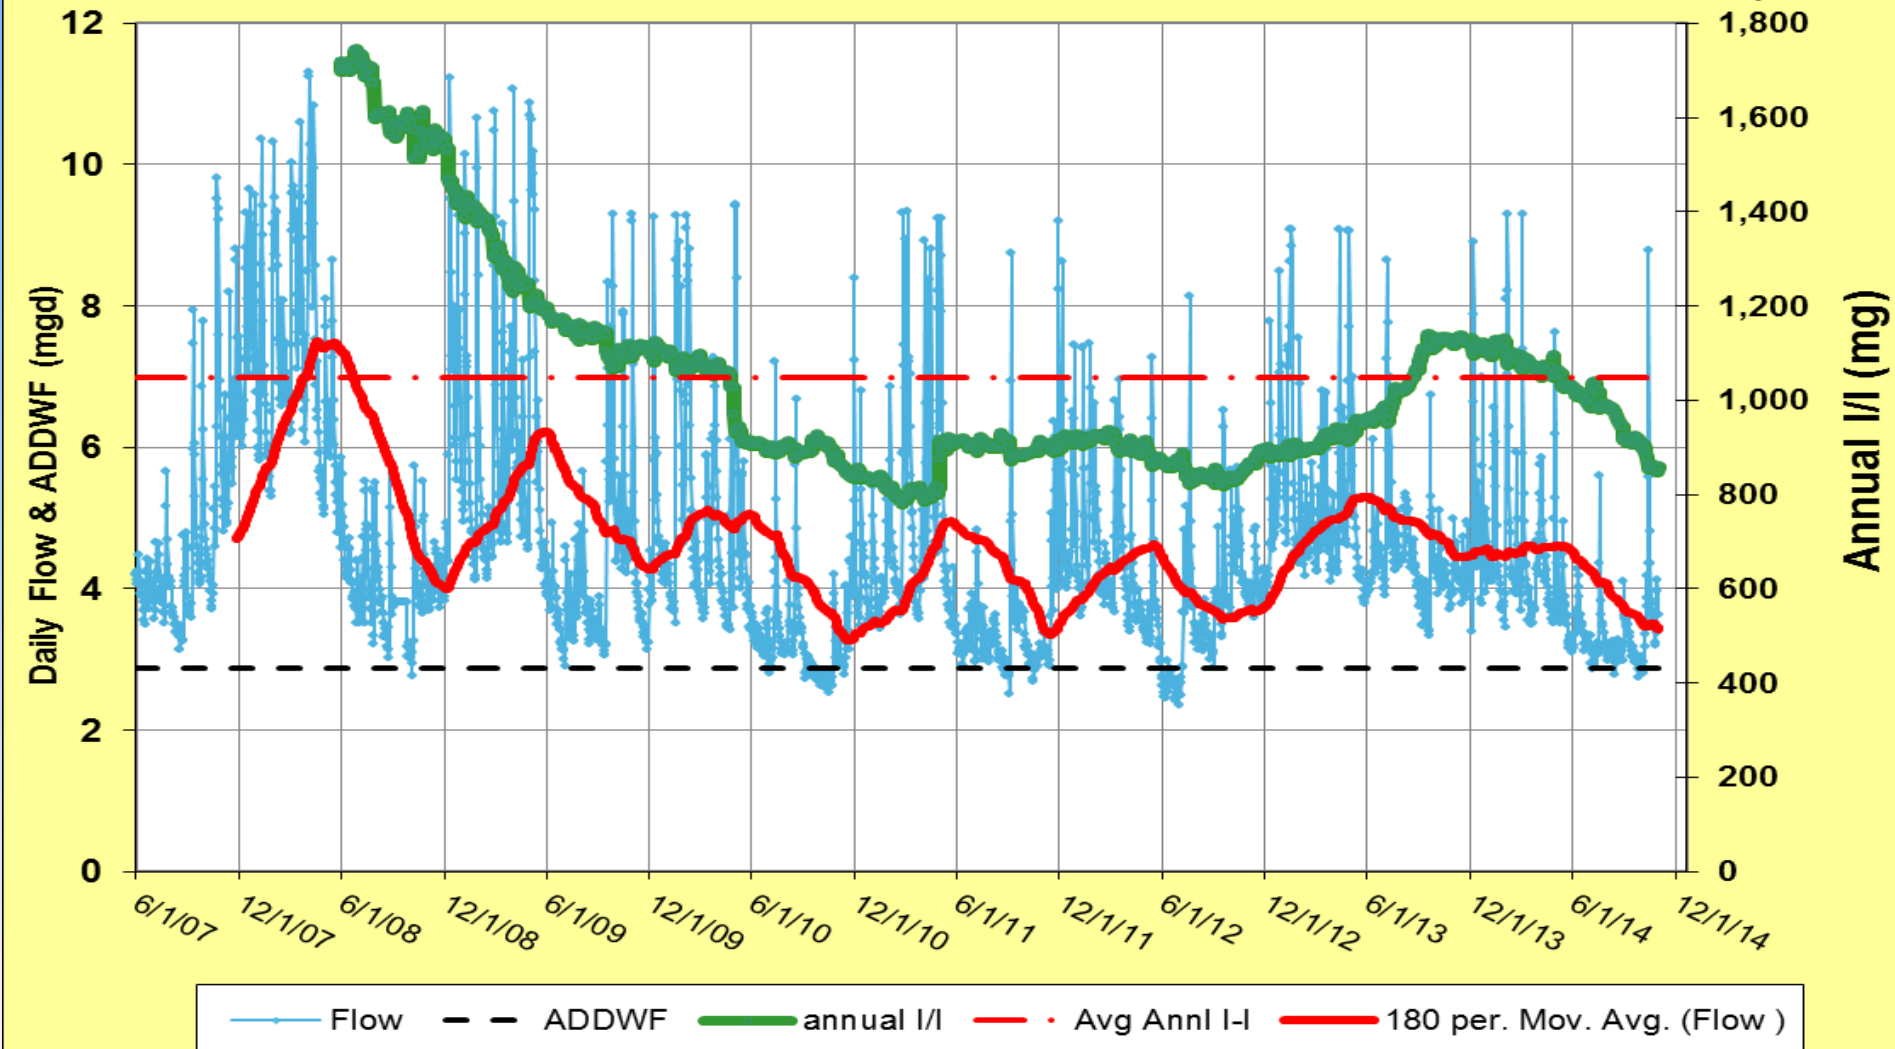

REHABILITATION EFFECTIVENESS:


ANNUAL I/I REDUCTION FROM REHABILITATION Nashville & Brentwood

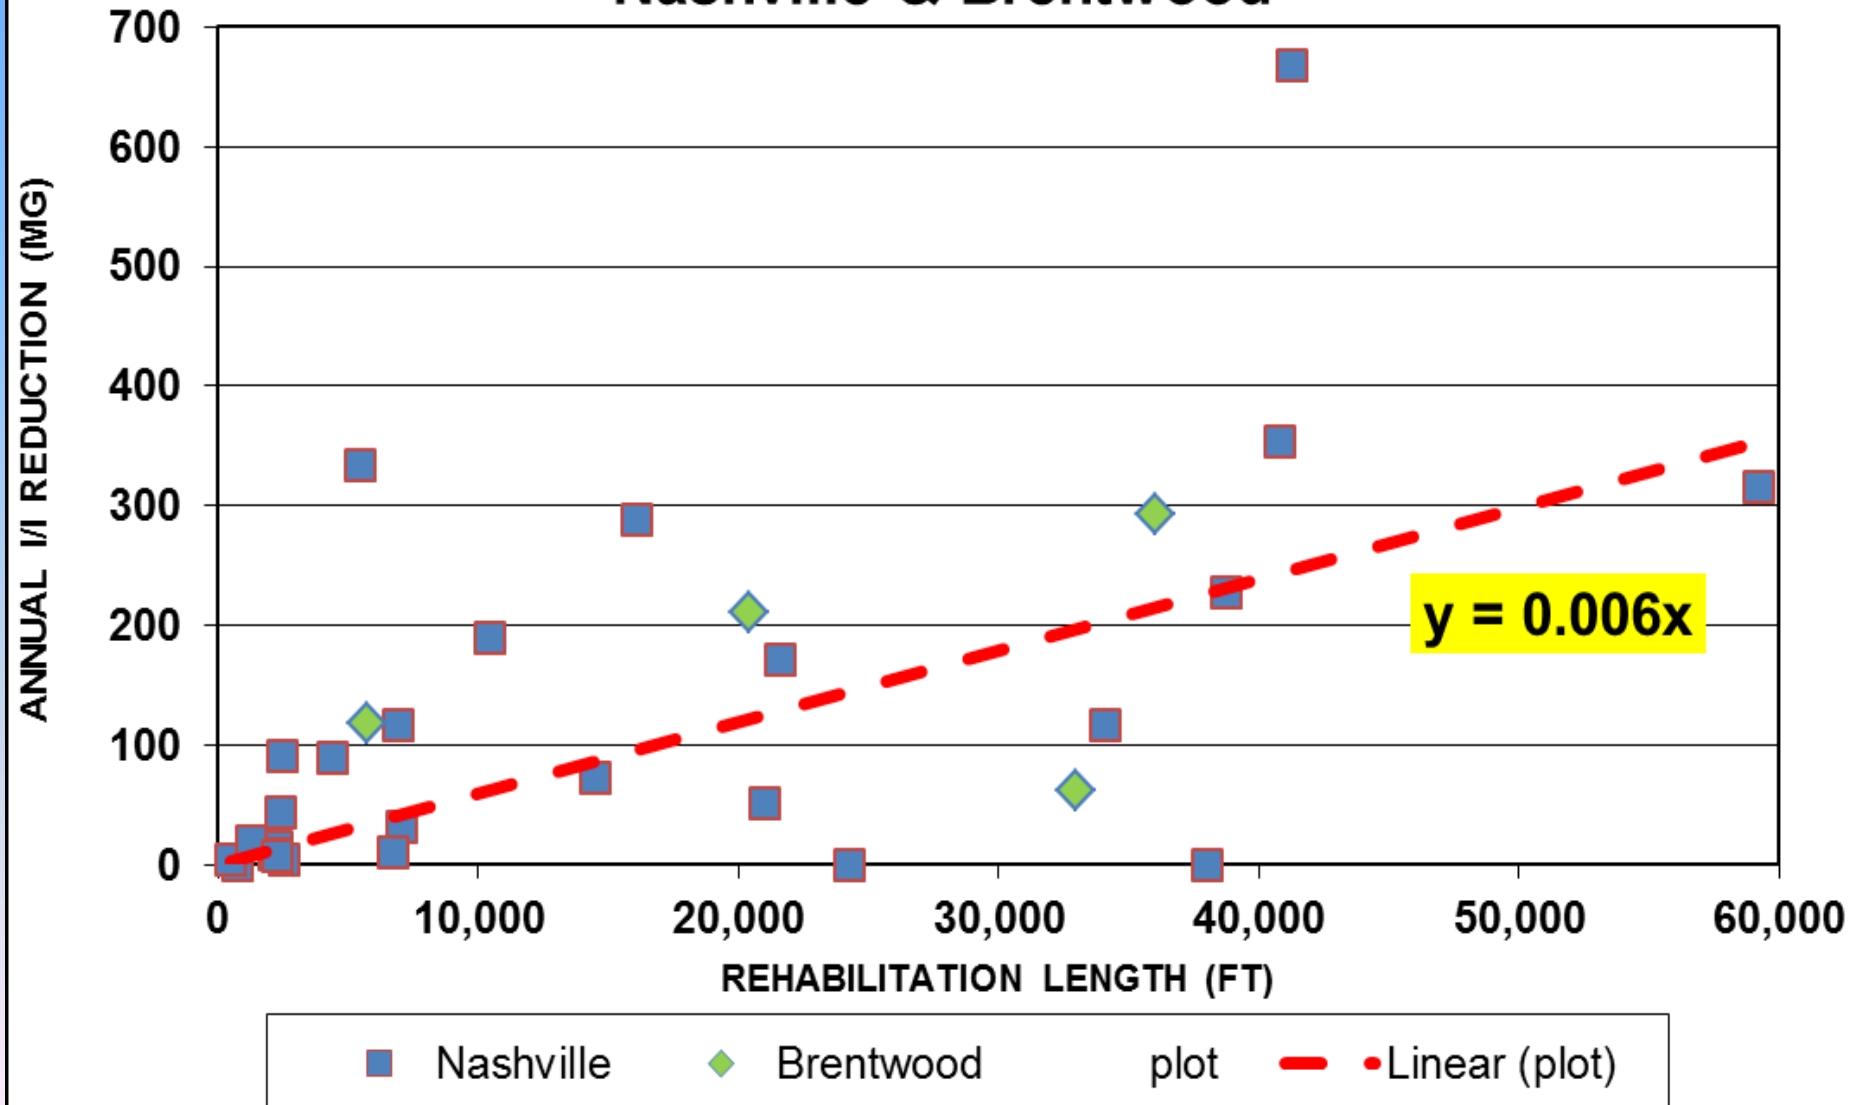

Effectiveness (a “rule of thumb”)

**15-20%
(Minimum)
REHABILITATION
INTENSITY**

**(including MH & laterals,
& in deteriorated areas)**

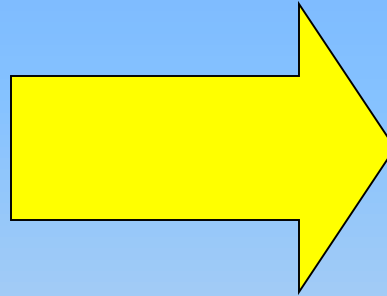

**~ 6 million
Gallons
annually**
**(Per 1,000 ft. Lining
or Replacement)**

Successful Rehab Factors

- Define goals
- Extensive flow monitoring & standard procedures for analysis
- System approach – lateral & manhole rehabilitation
- “Targeting” – stop water migration
- Accountability – verify desired results

Ten Step Strategy

- Identify Goals
- Select Target Area
- Quantify Problem
- Locate Defects
- Select Pipe Segments
- Estimate Cost-Benefit
- Design & Install
- Verify Performance
- Follow-up Flow Monitoring
- Calculate O & M Savings

1 – Identify Community Goals

“Eliminate overflows and basement backups”

- Period of time: 2 years?, 5 years?
- Relate time to rainfall event return interval
- No overflows legally sanctioned



2 – Select (and Characterize) Target Area

- Flow monitoring network (~100,000 L.F.)
 - subdivide the system
- Identify capacity problems
- Calculate observed & potential I/I
- Hydraulic model
- **Prioritize tributary areas**


Results of the Flow Monitoring

- Three Perspectives
 - Wet Weather
 - Dry Weather
 - Year-round (Annual I/I)

Wet Weather Problem

REGRESSION ANALYSIS
PEAK I/I vs 24-HOUR RAINFALL

ROCKFORD
INTERCEPTOR
(2011-12)

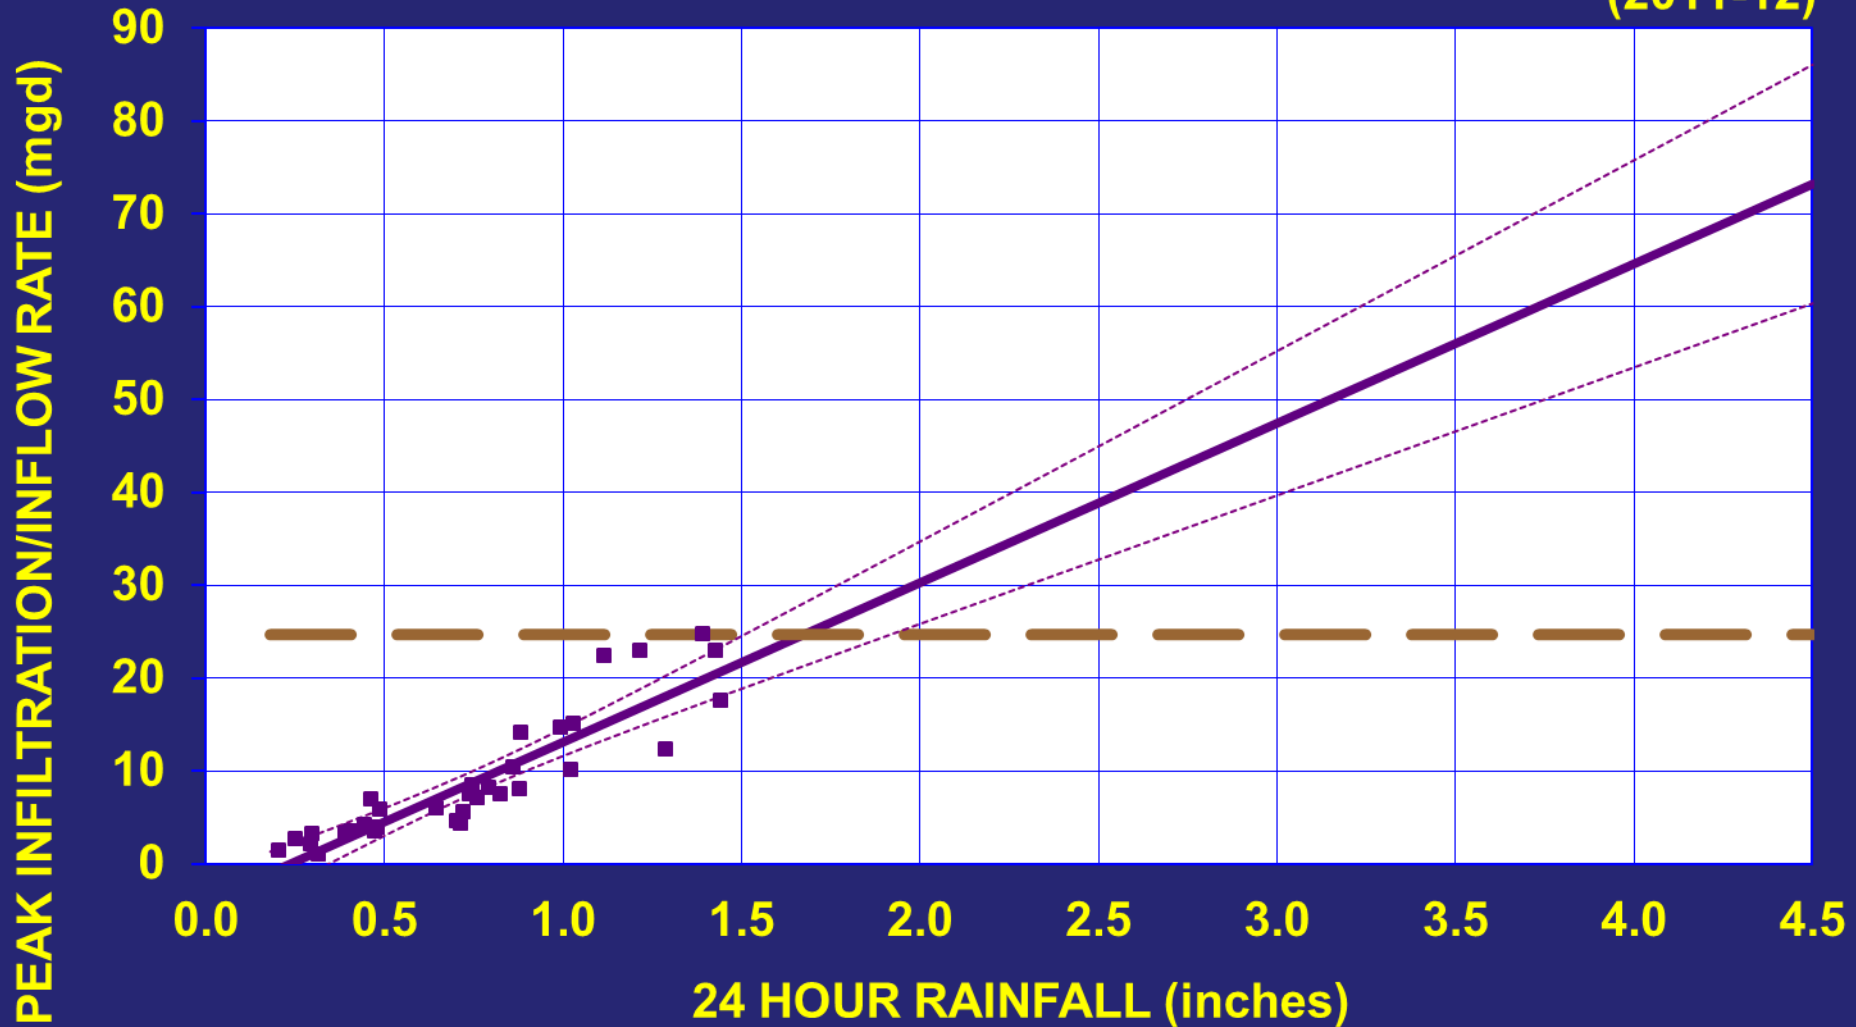


■ PEAK HOUR RAIN I/I — PEAK HOUR BEST FIT LINE — REMAINING CAP.(I/I) - - - 95% CONFIDENCE - - - 95% CONFIDENCE


Dry Weather Problem

Characteristic Base Flow Curve - Full Week

ROCKFORD SCHOOL

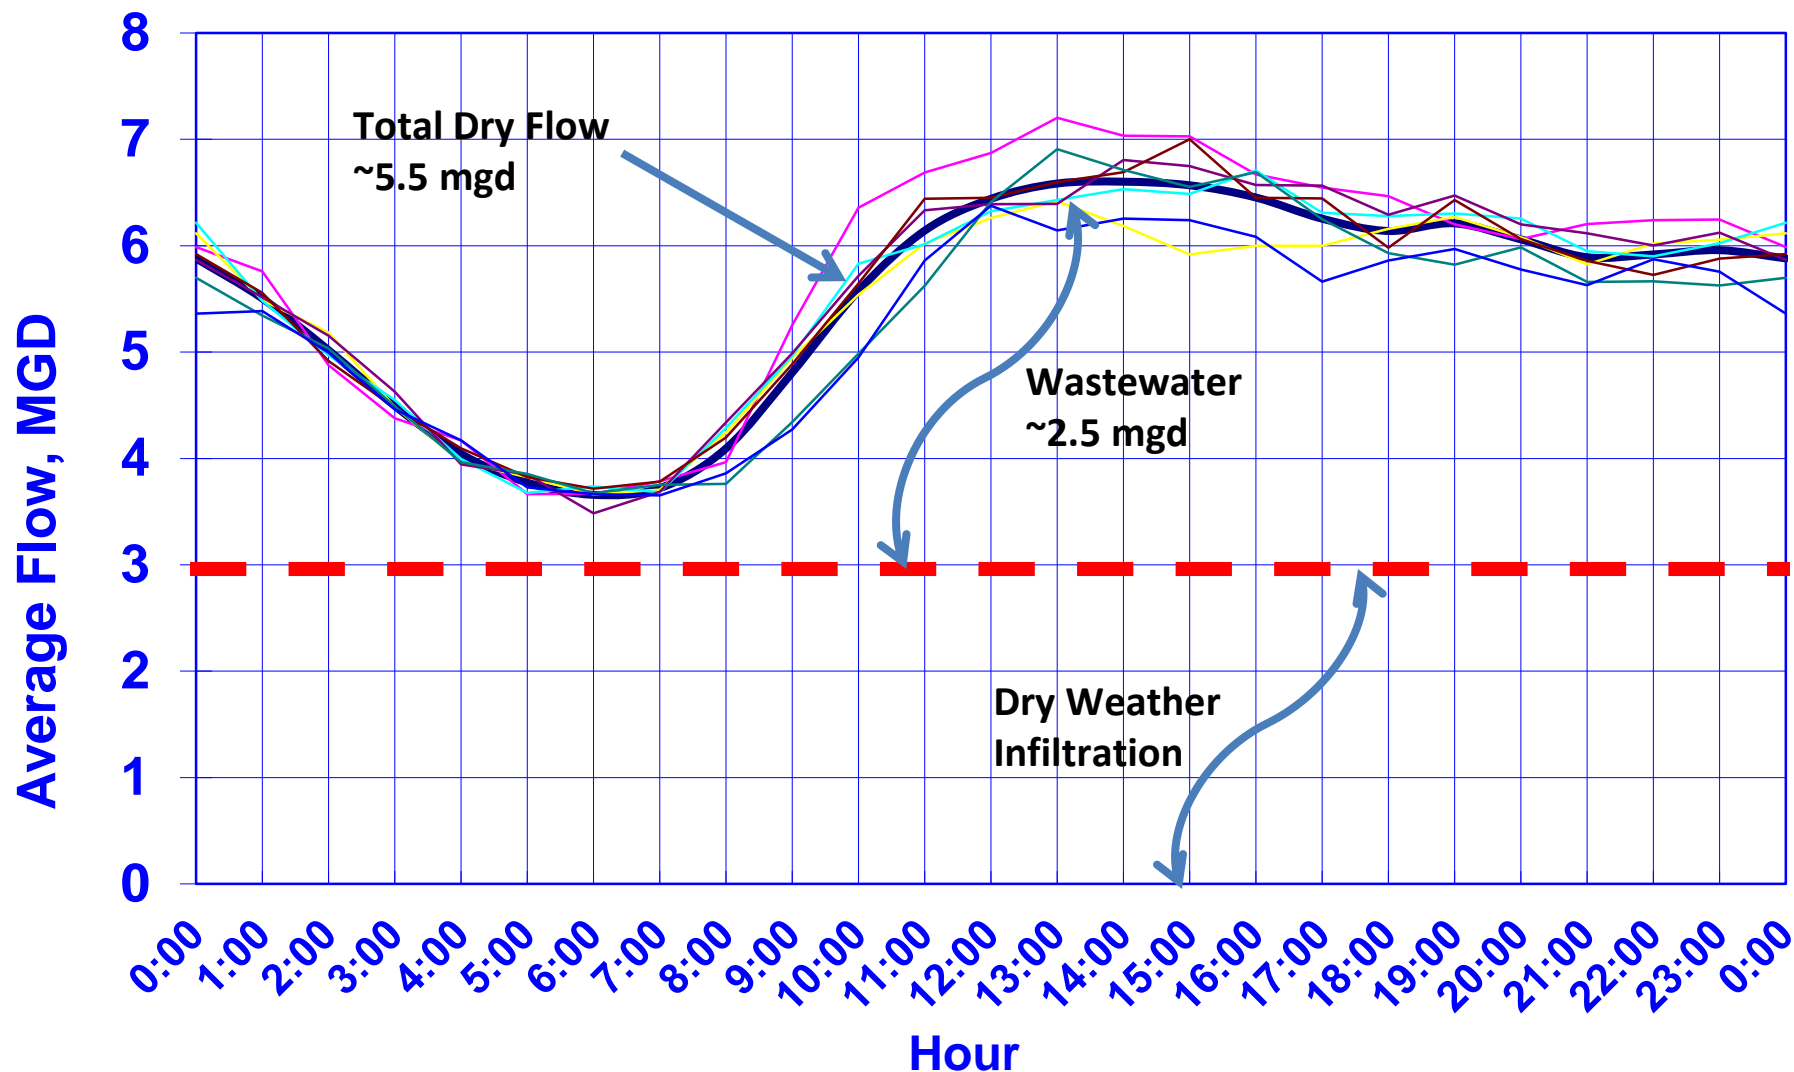

Maryville: Year-Round Problem

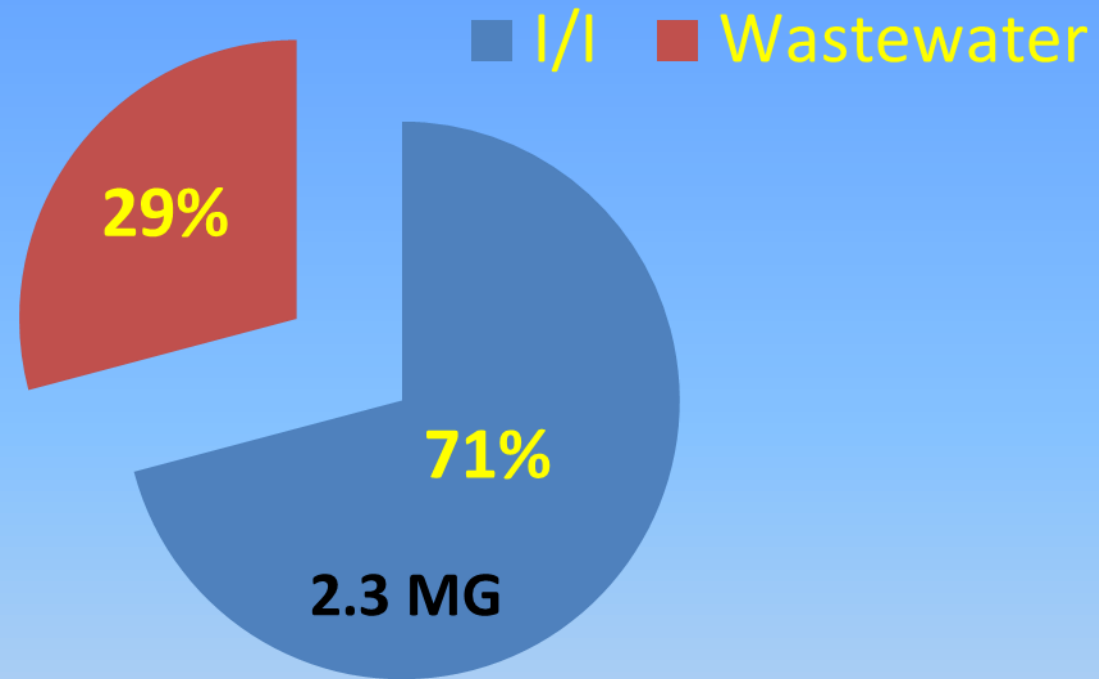


Nearly $\frac{3}{4}$ of System Annual Flow is Rainwater or Groundwater

(this equates to 2.4 gal I/I per gallon of wastewater)


2 – Select Target Area (Cont.)

Divide System For Monitoring

Brush Creek WWTP RDII (June '04 - May '05)

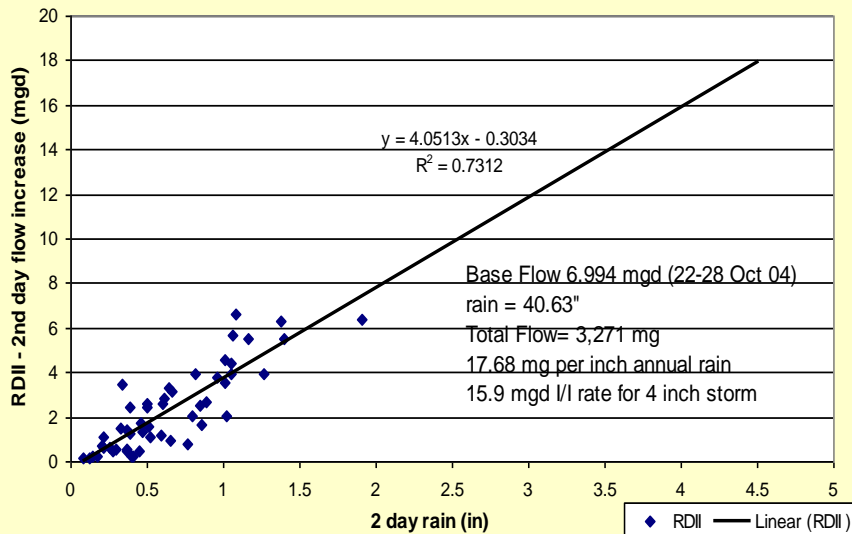


/=/

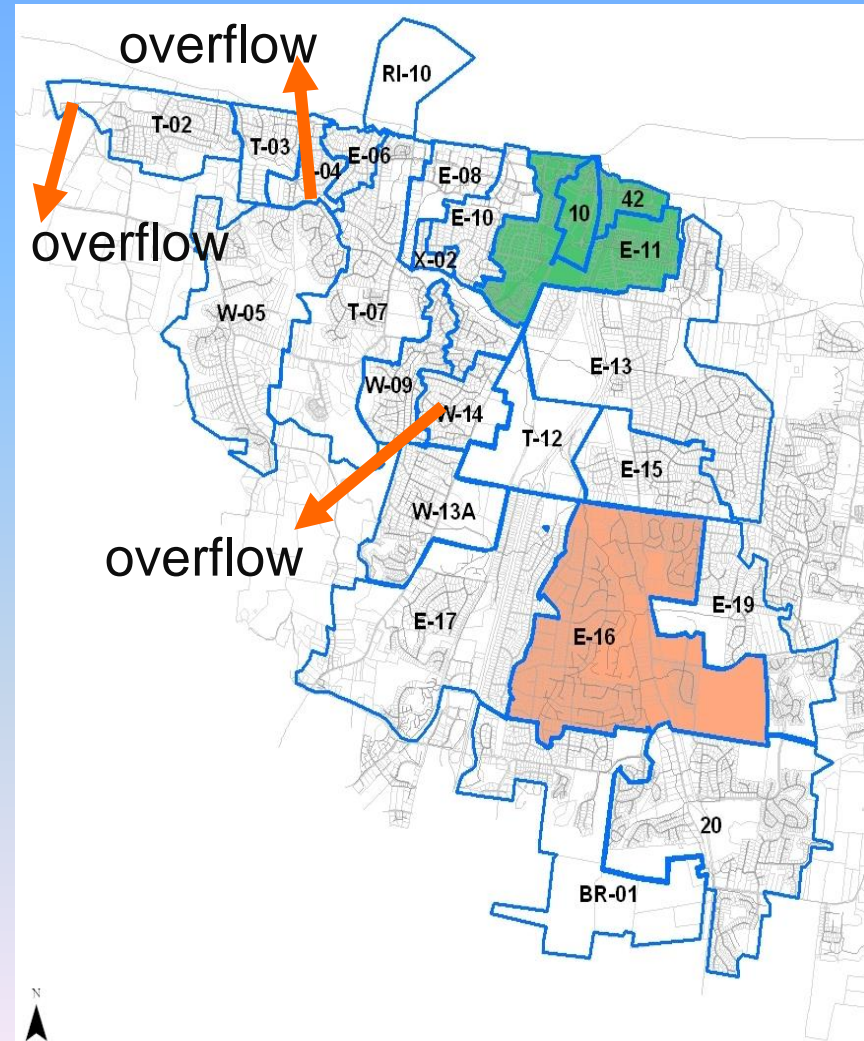

I/I measurements based solely on Treatment Plant influent data will usually underestimate system I/I due to overflow losses and hindered flow.

2 – Select Target Area (Cont.)

Total System: Pick Priority Area

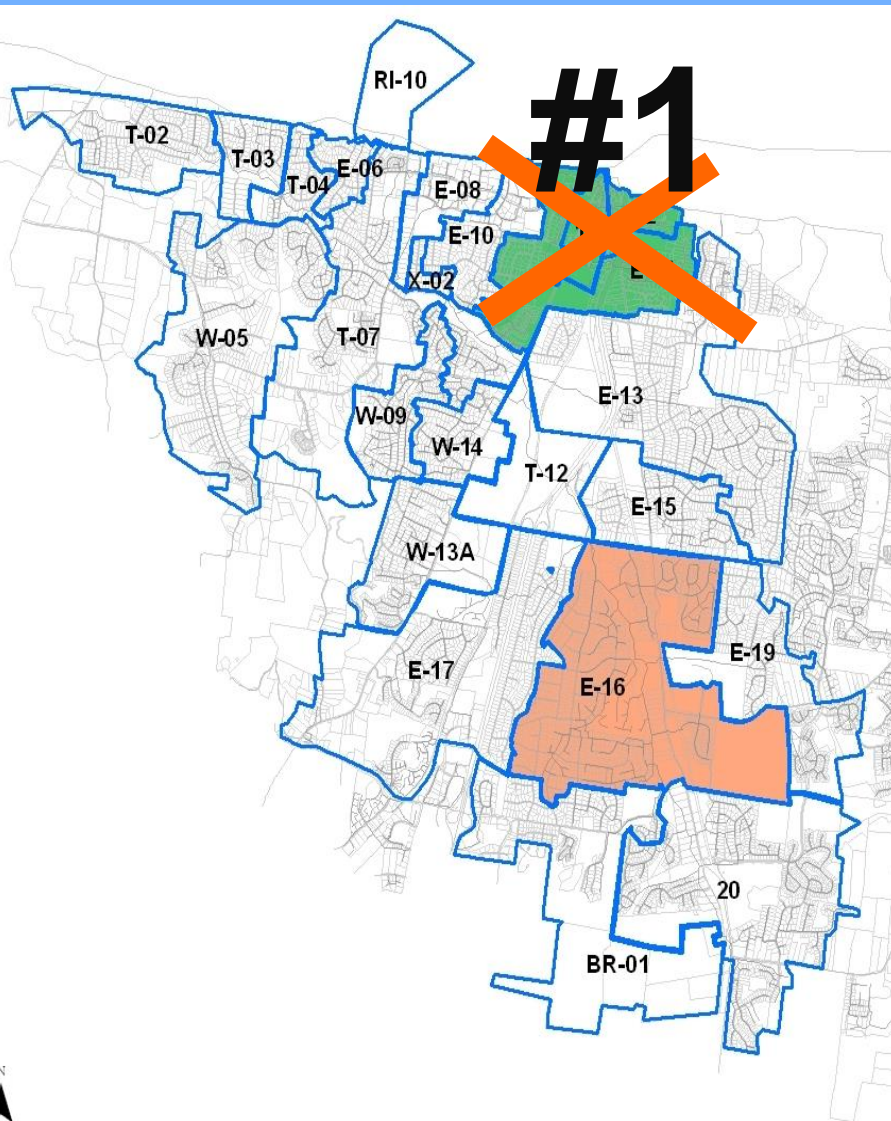

Criteria:

- Overflows
- Annual I/I
- Peak I/I
- Condition


Knock it Out !

3 - Quantify Problem Conditions **(refine the process for the target areas)**


- Intensive monitoring in top priority tributary areas (8,000 - 15,000 LF)
- May try “micro monitoring”
- Observed and potential I/I
- Additional capacity problems

3 - Quantify Problem Conditions (cont.)

Hydraulic Capacity Analysis

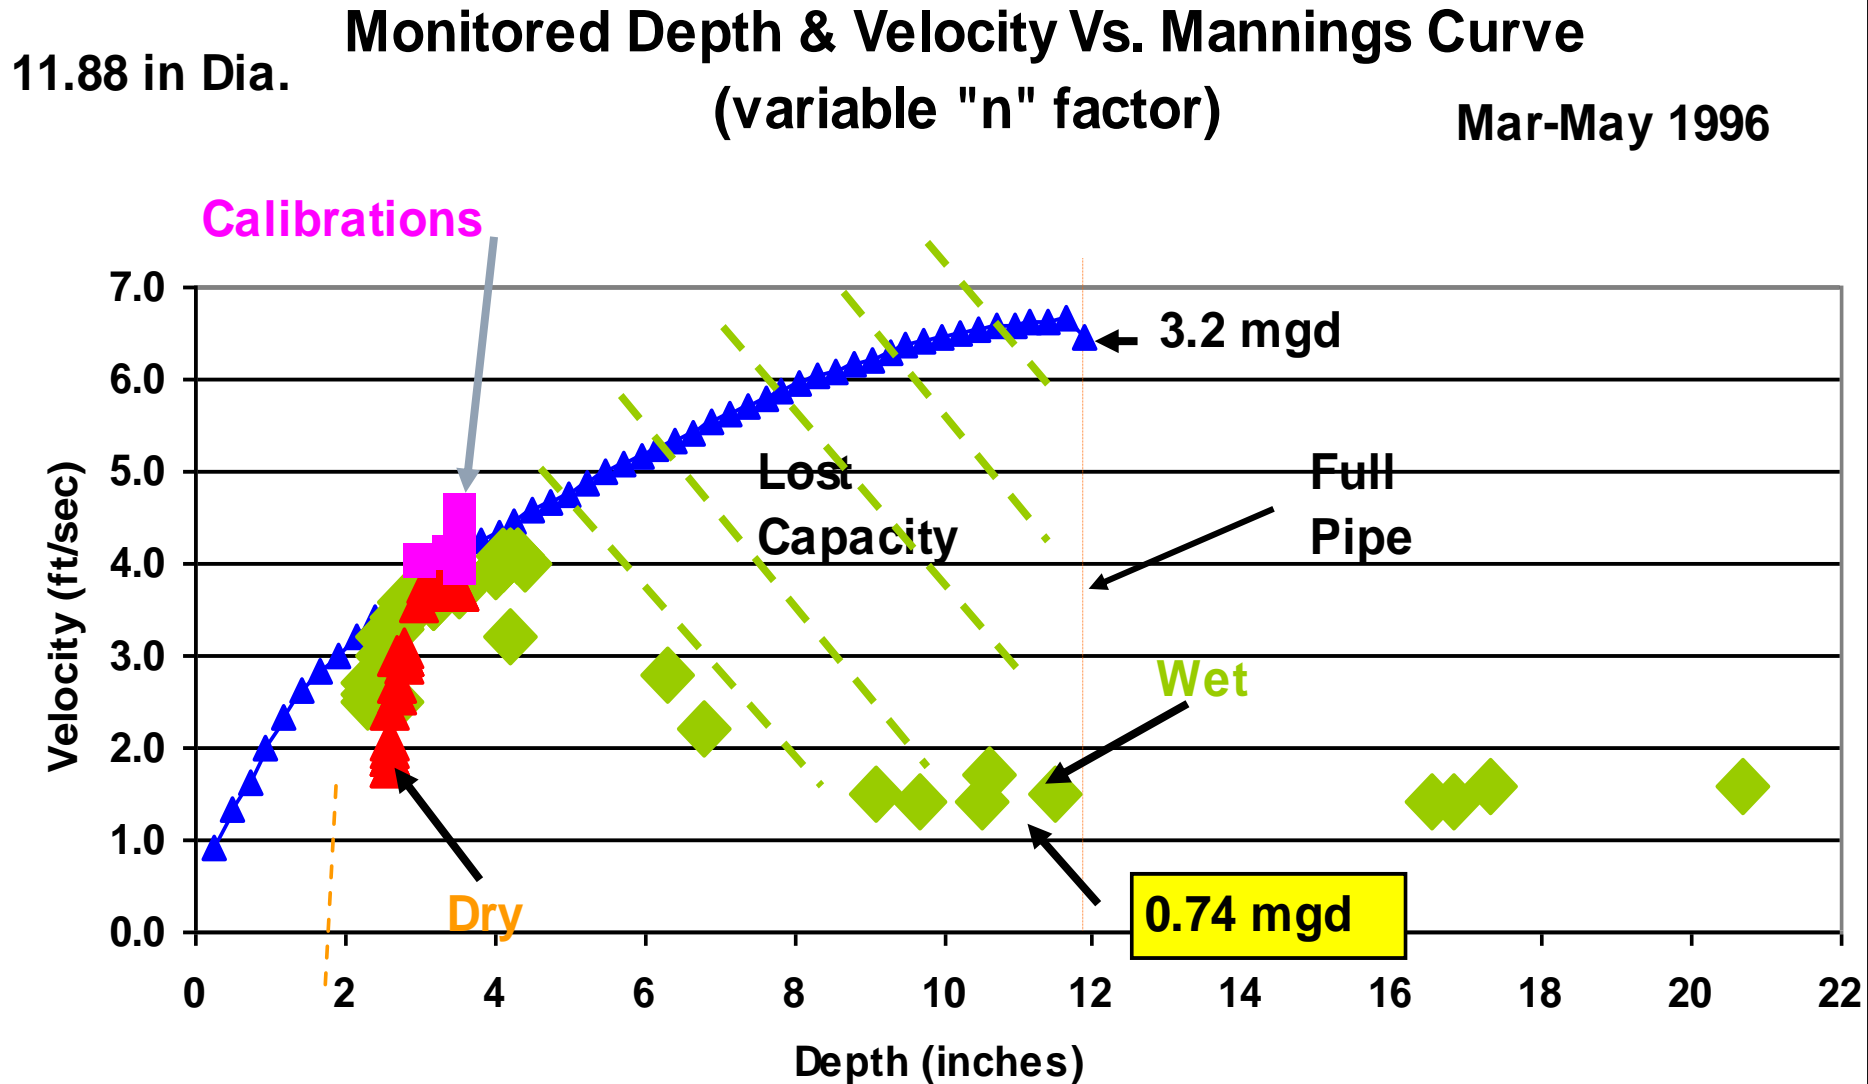

Quantify the I/I (Observed and Potential)

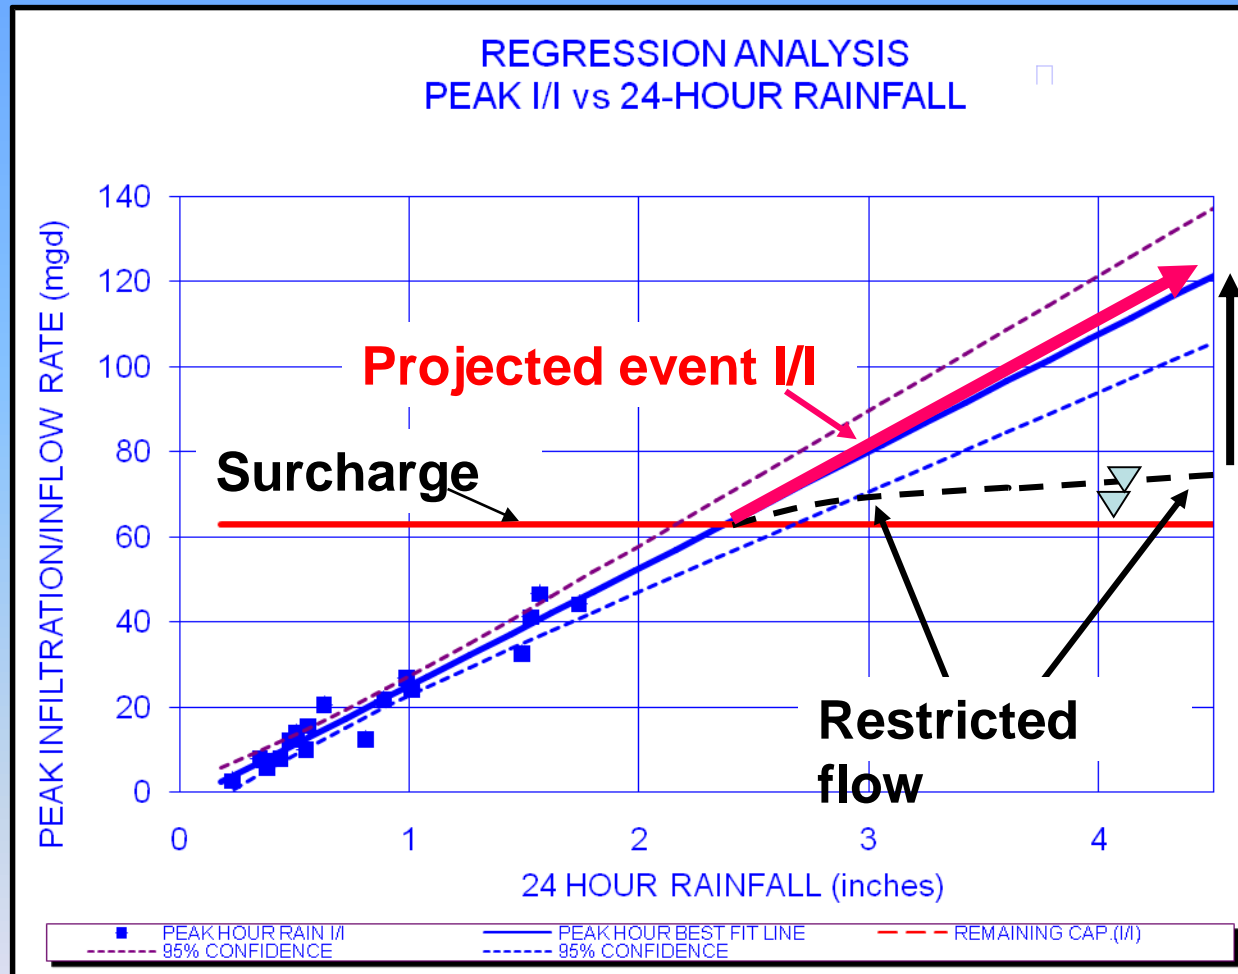

$r = 0.97$, 95% CONF. = 26%

3 - Quantify Problem Conditions (cont.)

“Potential” I/I

- I/I which cannot enter the sewer because the pipe is already overloaded!
- Obscures overall I/I removal goals
- Monitor depth & velocity
- Extrapolated

Monitoring in the upper reaches of a basin (upstream of significant hindered flow conditions) allows a more realistic estimate of I/I !

Data Interpretation

- **Need to standardize criteria**

- 24-hour rainfall more reliable than peak hour rain for predicting peak design I/I

- **AMC** – Antecedent Moisture Condition is critical for selecting valid rainfall events

- **Hindered flow** - Potential I/I There are ways to correct for this, however the analyst must be aware of this condition

- Underestimating the peak flow can result in inadequate design of new facilities

**Which type rainfall pattern puts the
most stress on the system – for a
standard return interval, design storm?**

Summer ?

Or Winter ?


Typical Rainfall

Type II Rainfall* – Characterized by short-term, high intensity thunderstorms and also by long-duration frontal storms.

*USDA-SCS 1986


NASHVILLE

5-Year, 24-Hour & 3-Hour Design Rainfall

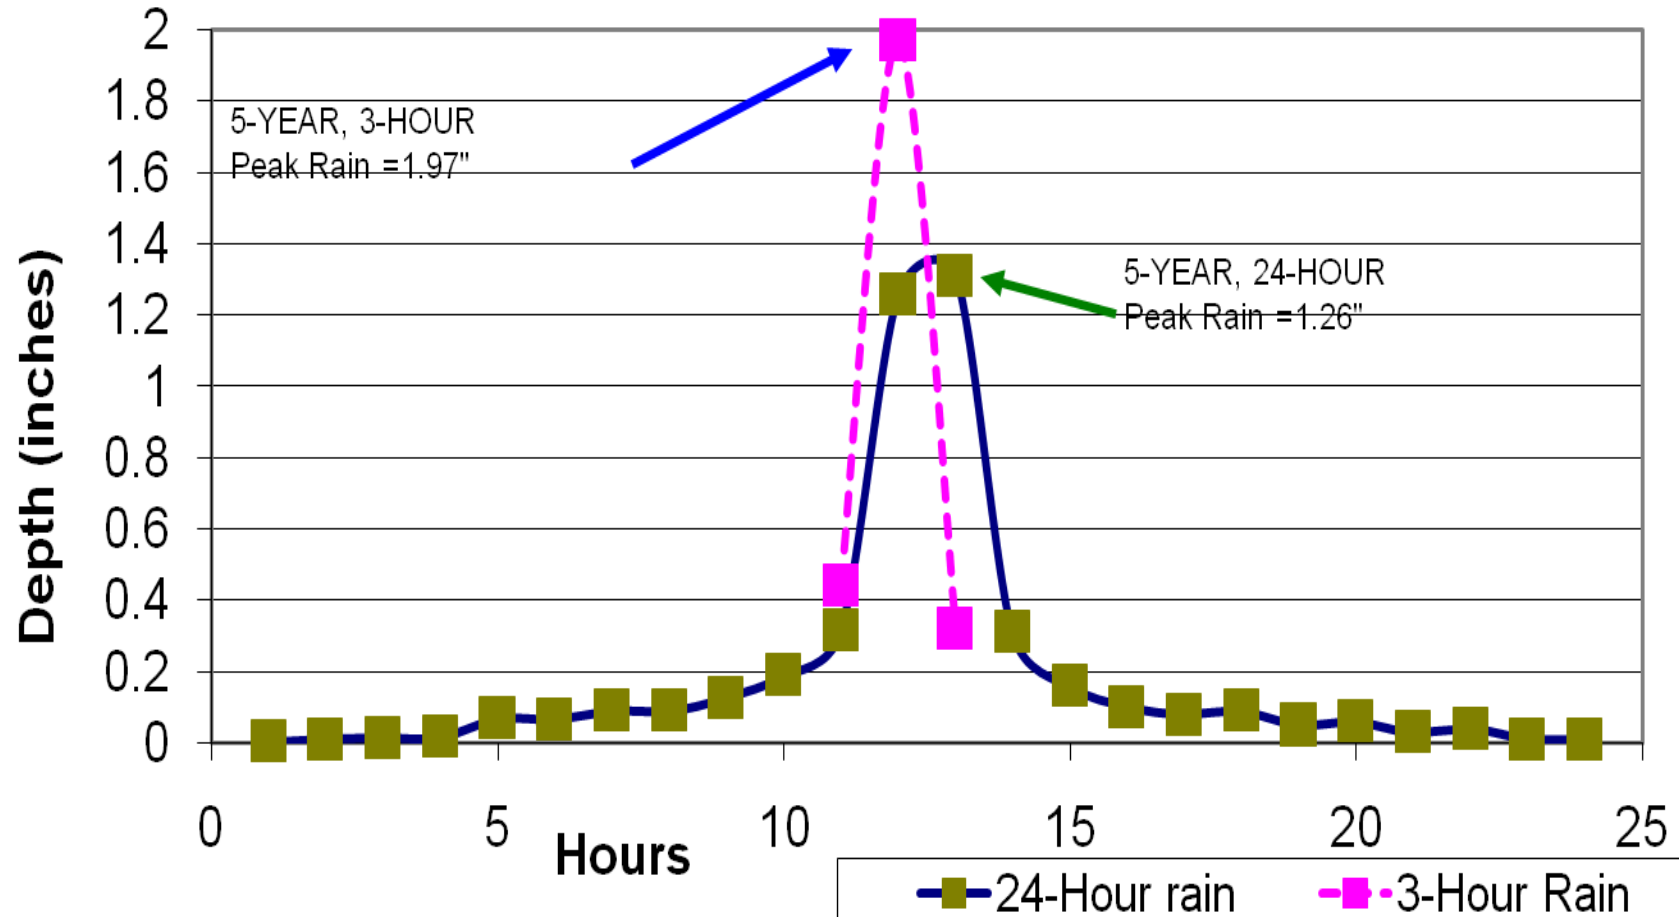

2-Year Design Storm Peak: 24-Hr vs. 3-Hr


PEAK I/I vs 24-HOUR RAINFALL

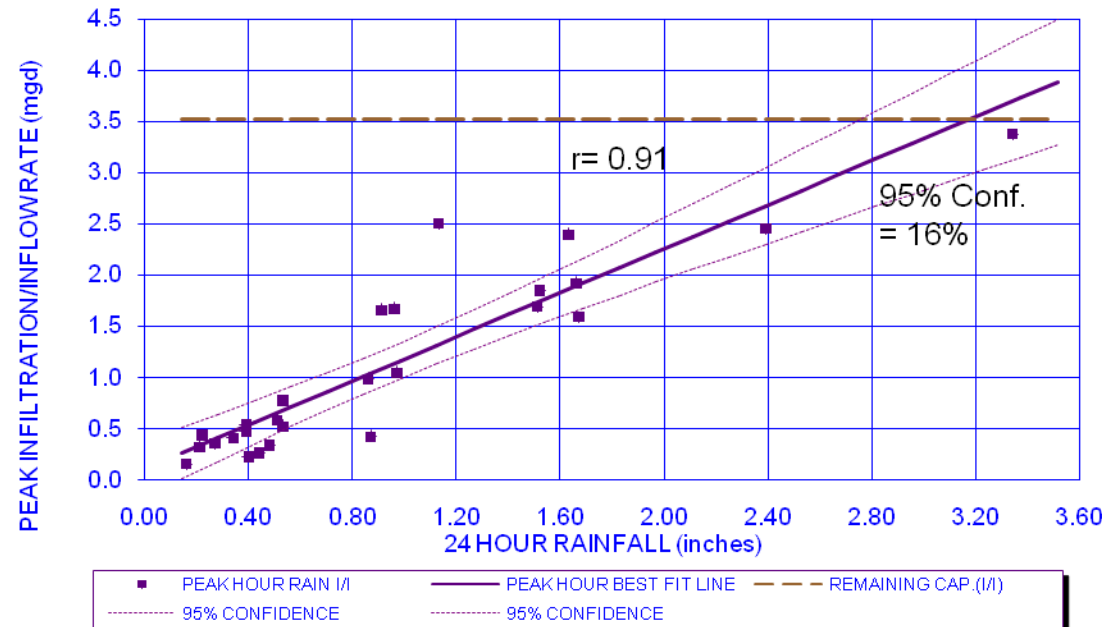

Peak hour I/I from 2-Yr,
24-Hr Storm is 2.89 mgd
with good level of
confidence



PEAK I/I vs 3-HOUR RAINFALL

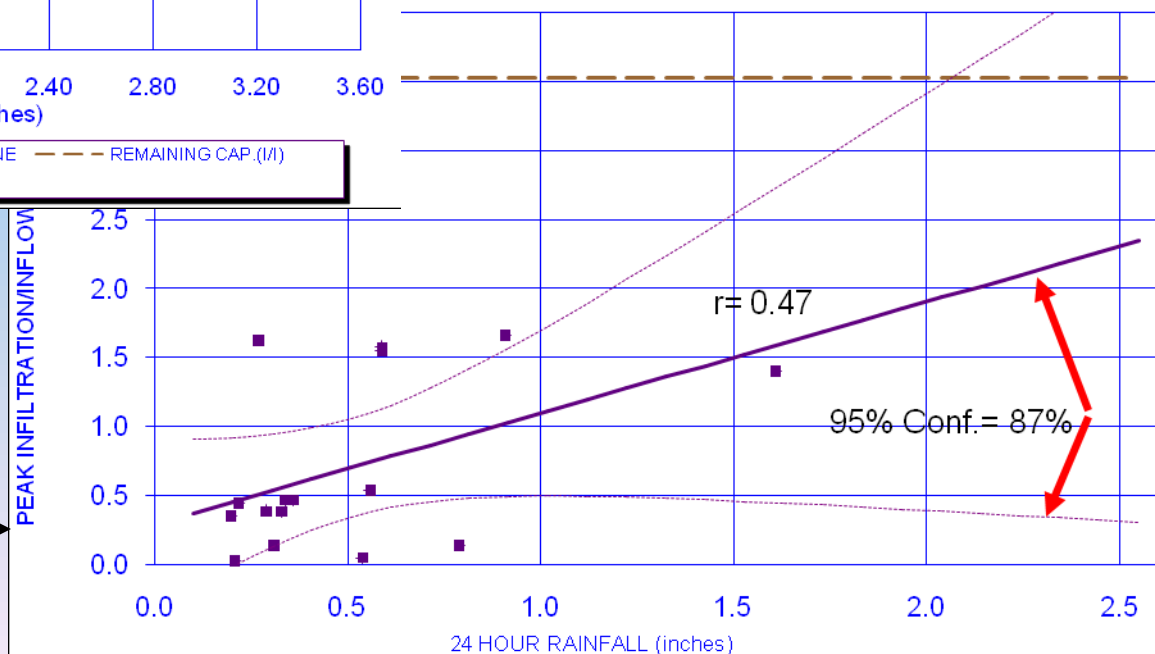

Peak hour I/I from 2-Yr,
3-Hr Storm is 2.35 mgd
with poor level of
confidence



4 - LOCATE & IDENTIFY DEFECTS



- Televisive target area system (may be concurrent with monitoring)
- Alternative: “Electro Scan”
- Categorize defects with respect to I/I potential



4 - Locate & Identify Defects (Cont.)

- “Invisible” defects – electric field leak detection, segmental isolation
- Gross inflow (roof drains, etc.)


Focused Electric Field Test

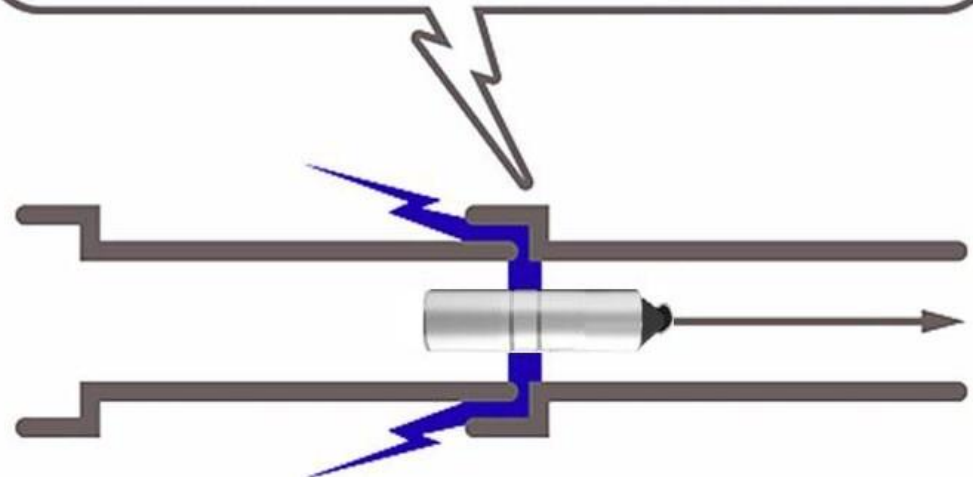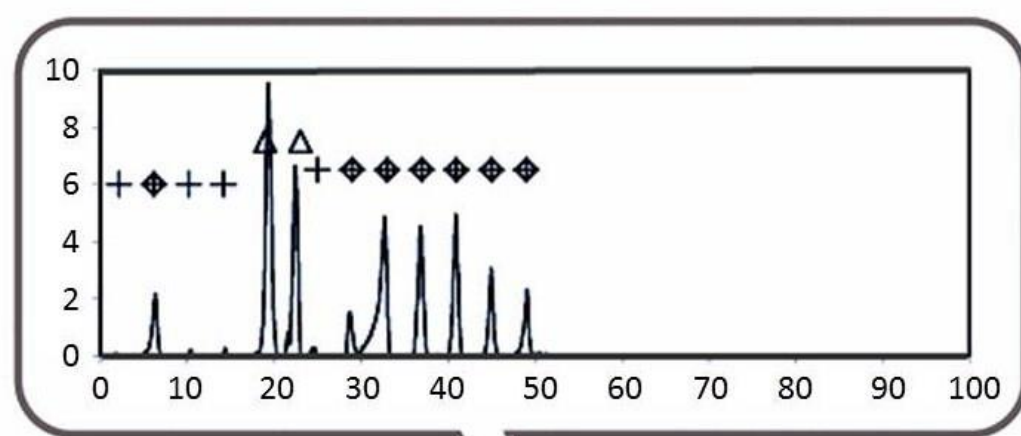


5 - Select Segments For Rehabilitation

- Categorize & color code lines
 - 3 or more major defects
 - 1–2 major defects
 - No major defects
- “3 or more” – renew!
- Check adjacent segments
- Renewal “intensity” – range of 15–20% (or greater) in first round

Connect The Dots

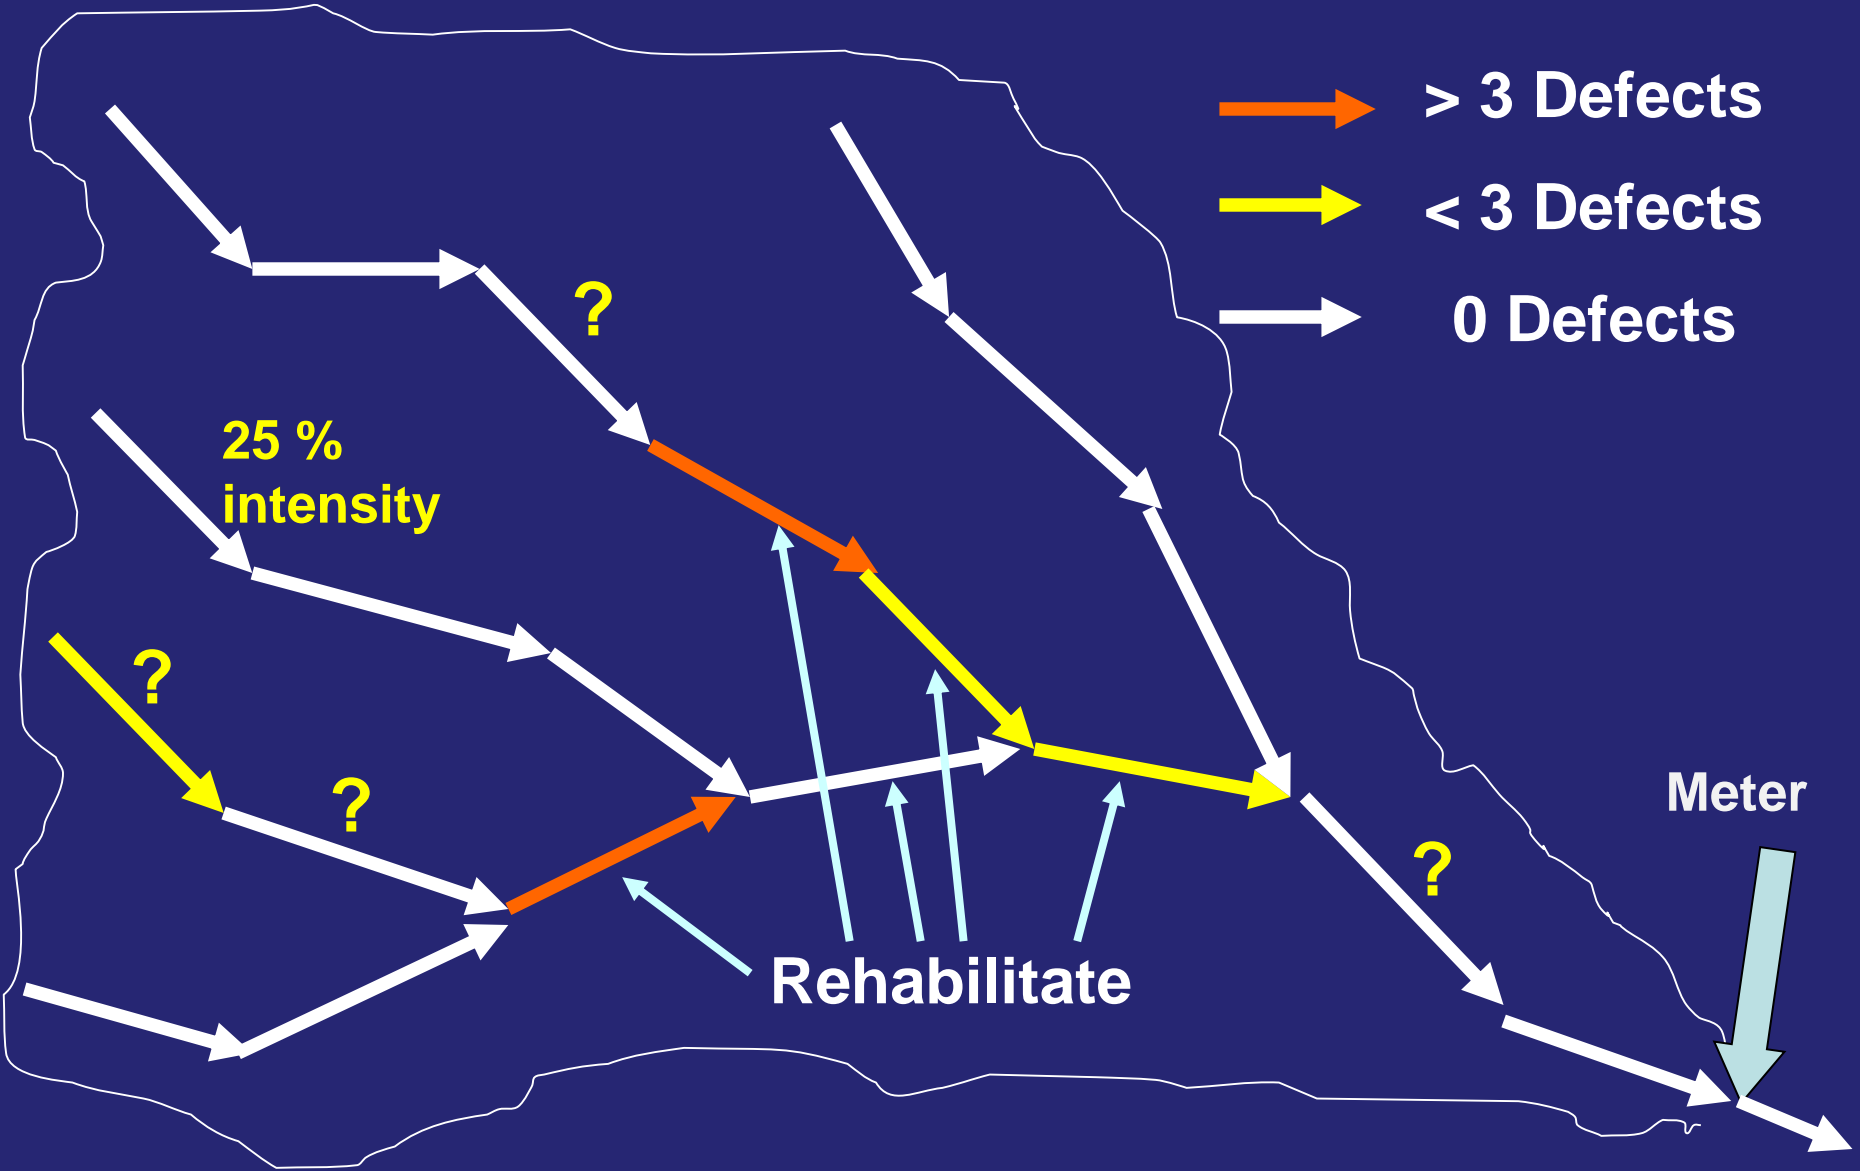

Sewer Rehab Strategy: Halt Migration!

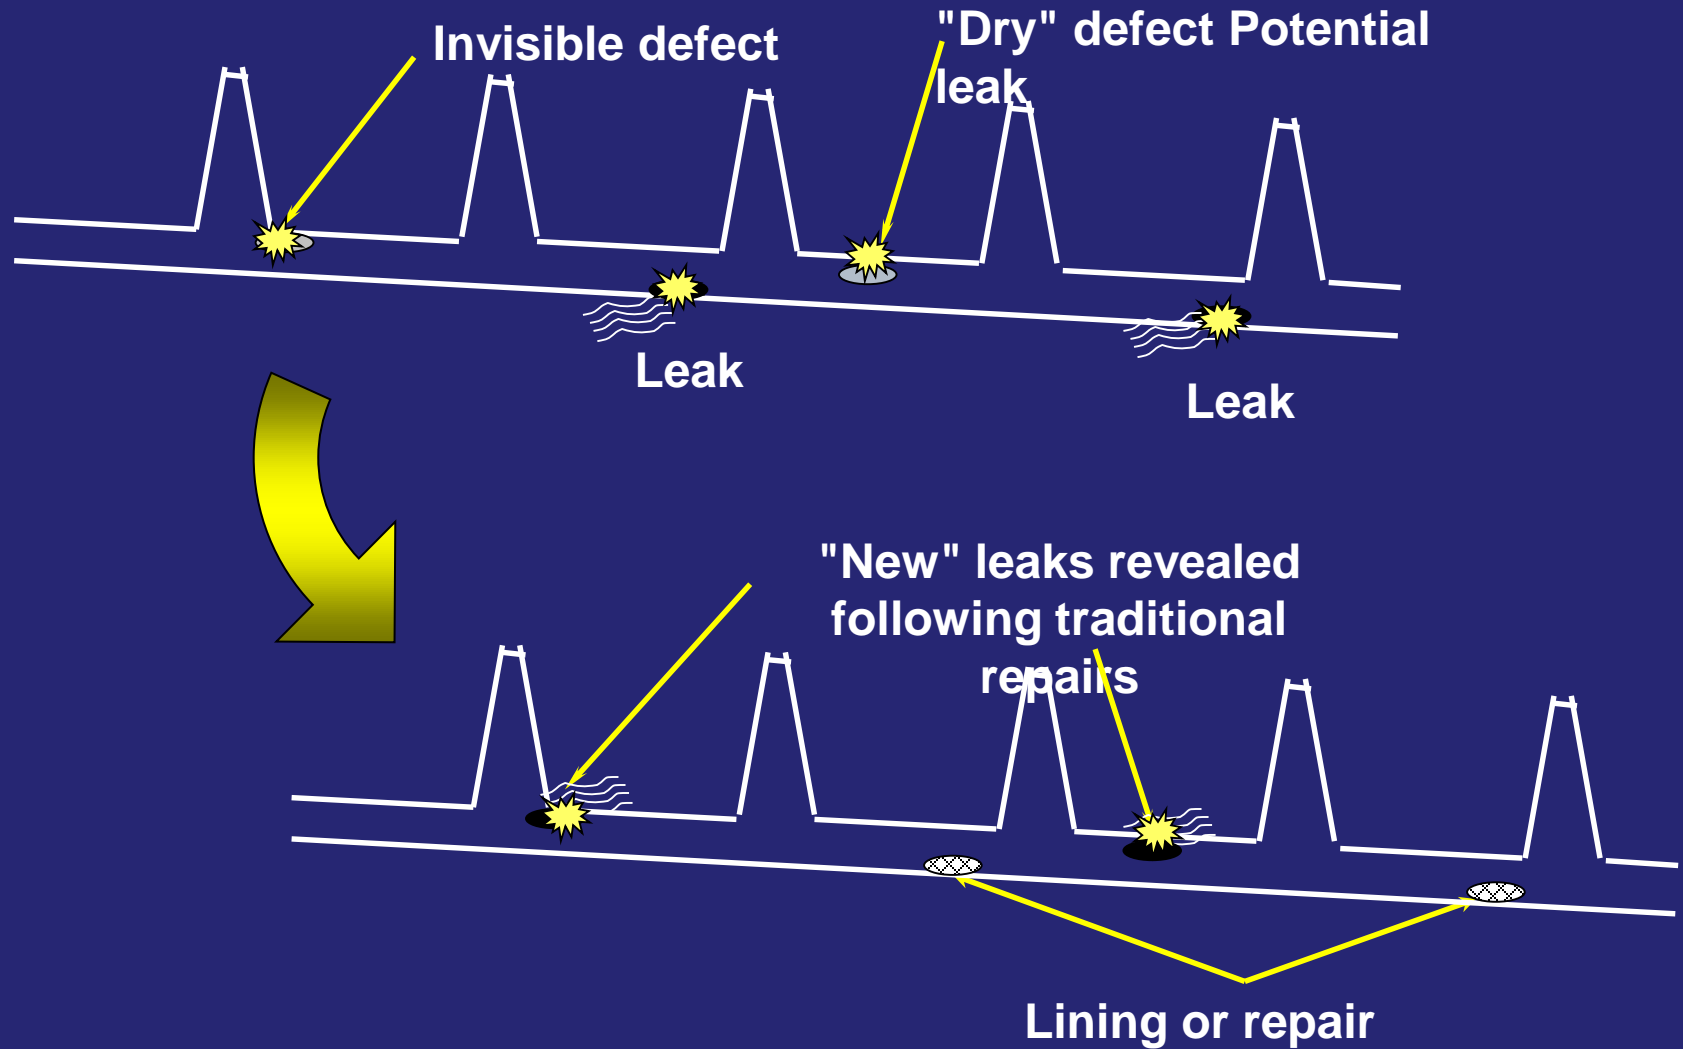

6 - ESTIMATE COST-BENEFIT

- Compare renewal costs to: O & M costs
(\$1.73 – \$1.87/ 1,000 gal)
- At least 50% I/I removal
- Costs:
 - Lining (8–10" cipp) ~ \$43 / lf
 - Laterals ~ \$2,500 ea. (1/ 200 lf)
 - Manholes ~ \$1,000 –1,300 ea. (1/200 lf)
 - Engineering ~ 12% – 15% of total
 - Owner's expenses (admin, etc.)


(Gross= ~\$100 to \$132/ft rehab)

7 - Design and Install Rehab

- Halt migration from outside pipe
- Halt migration (“tracking”) inside pipe
- Provide seal at manhole junction
- Renew service laterals

**Over 15,500 service
laterals rehabilitated in
Nashville’s Program**

Peak Hour I/I Reduction with Lateral Rehab

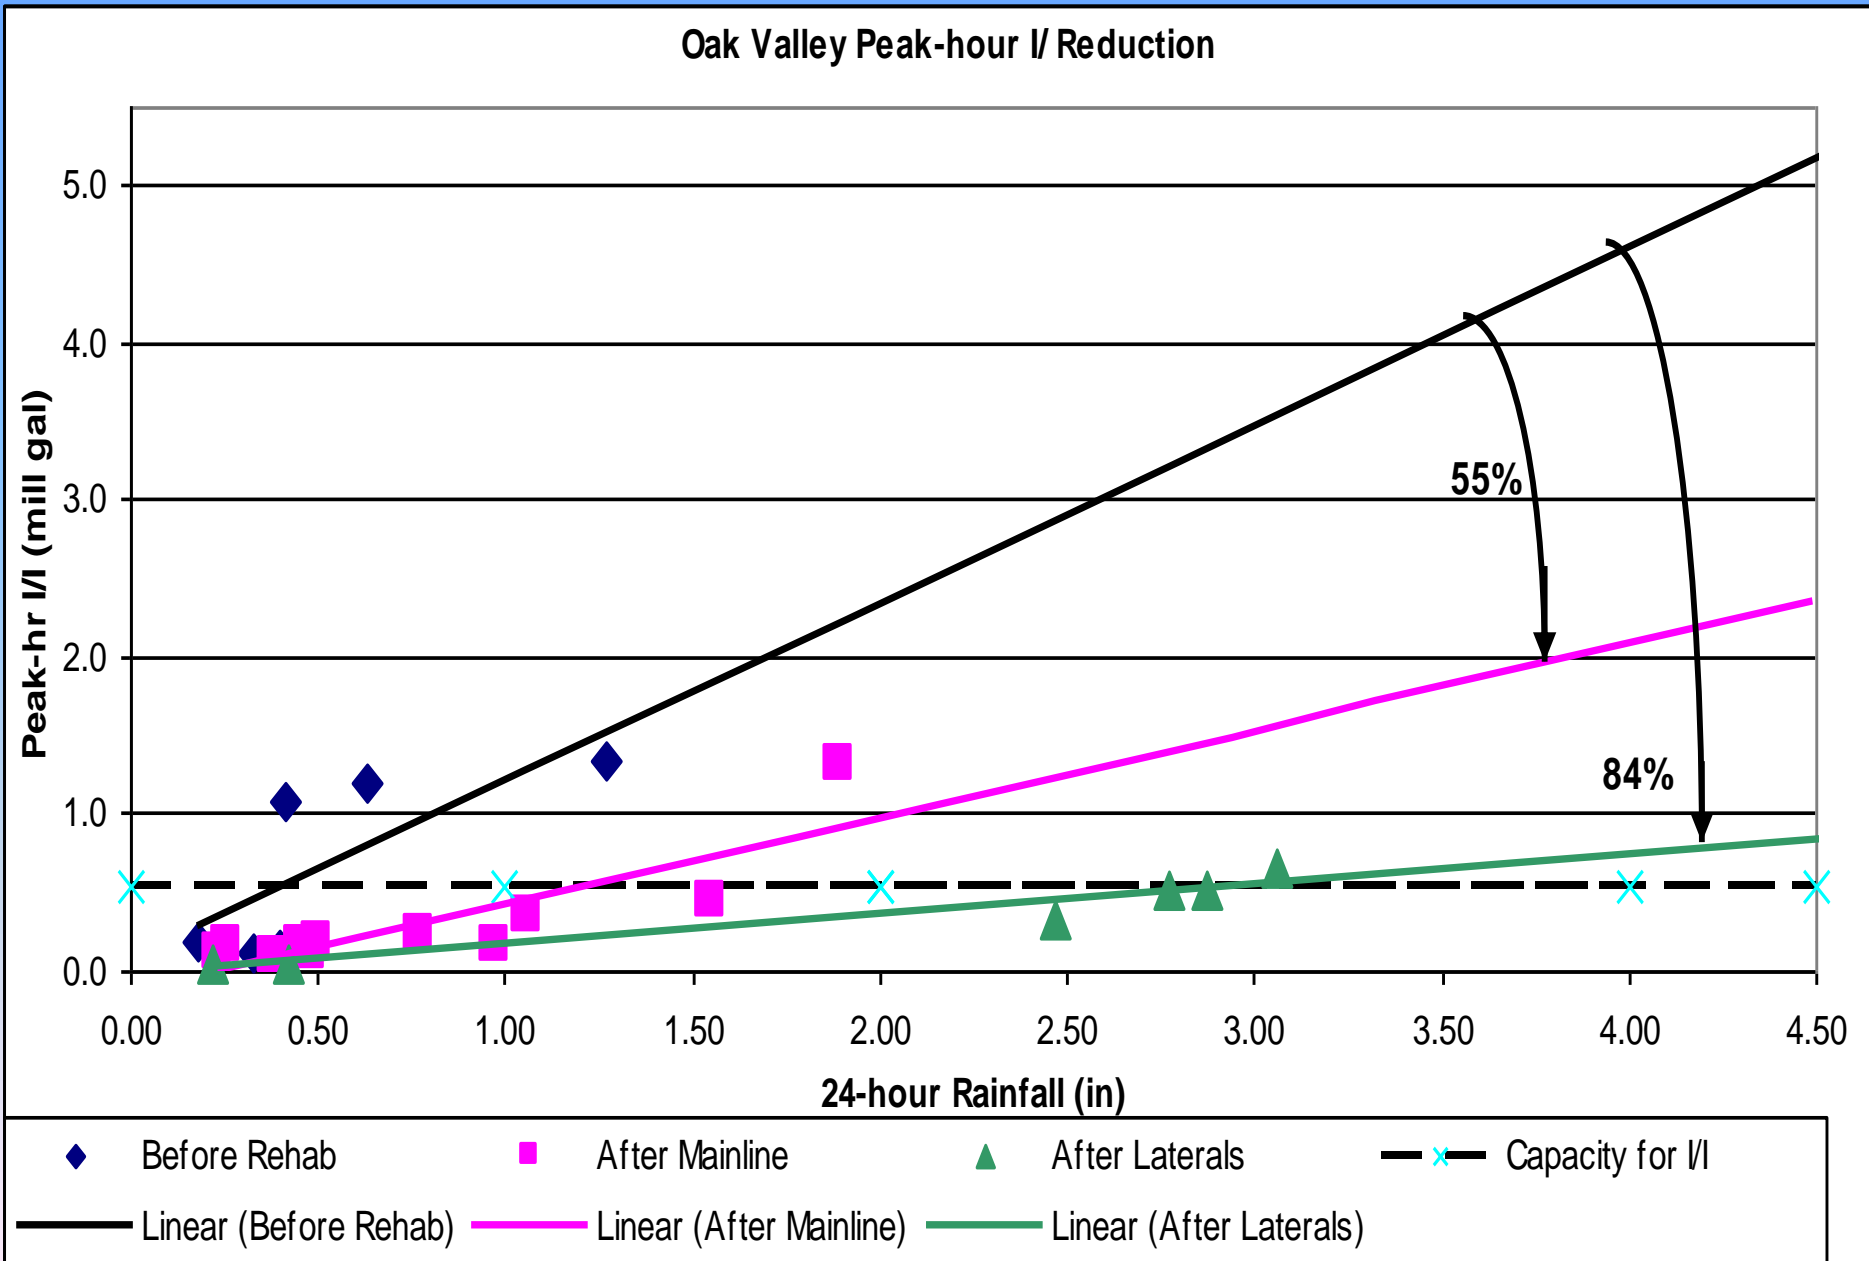

8 - Performance Testing

- Air-test sewer service connection!
 - Most vulnerable part
 - Not accepted until performance verified




9 - Follow-up Flow Monitoring

- Quantify I/I reduction
- Standardized I/I analysis
- TV during wet weather
- Rerun hydraulic model
- Determine if design goals met!

E-11 Before-After Peak-Hr I/I Reduction 2007- 2011

PEAK HOUR INFILTRATION/INFLOW RATE (mgd)

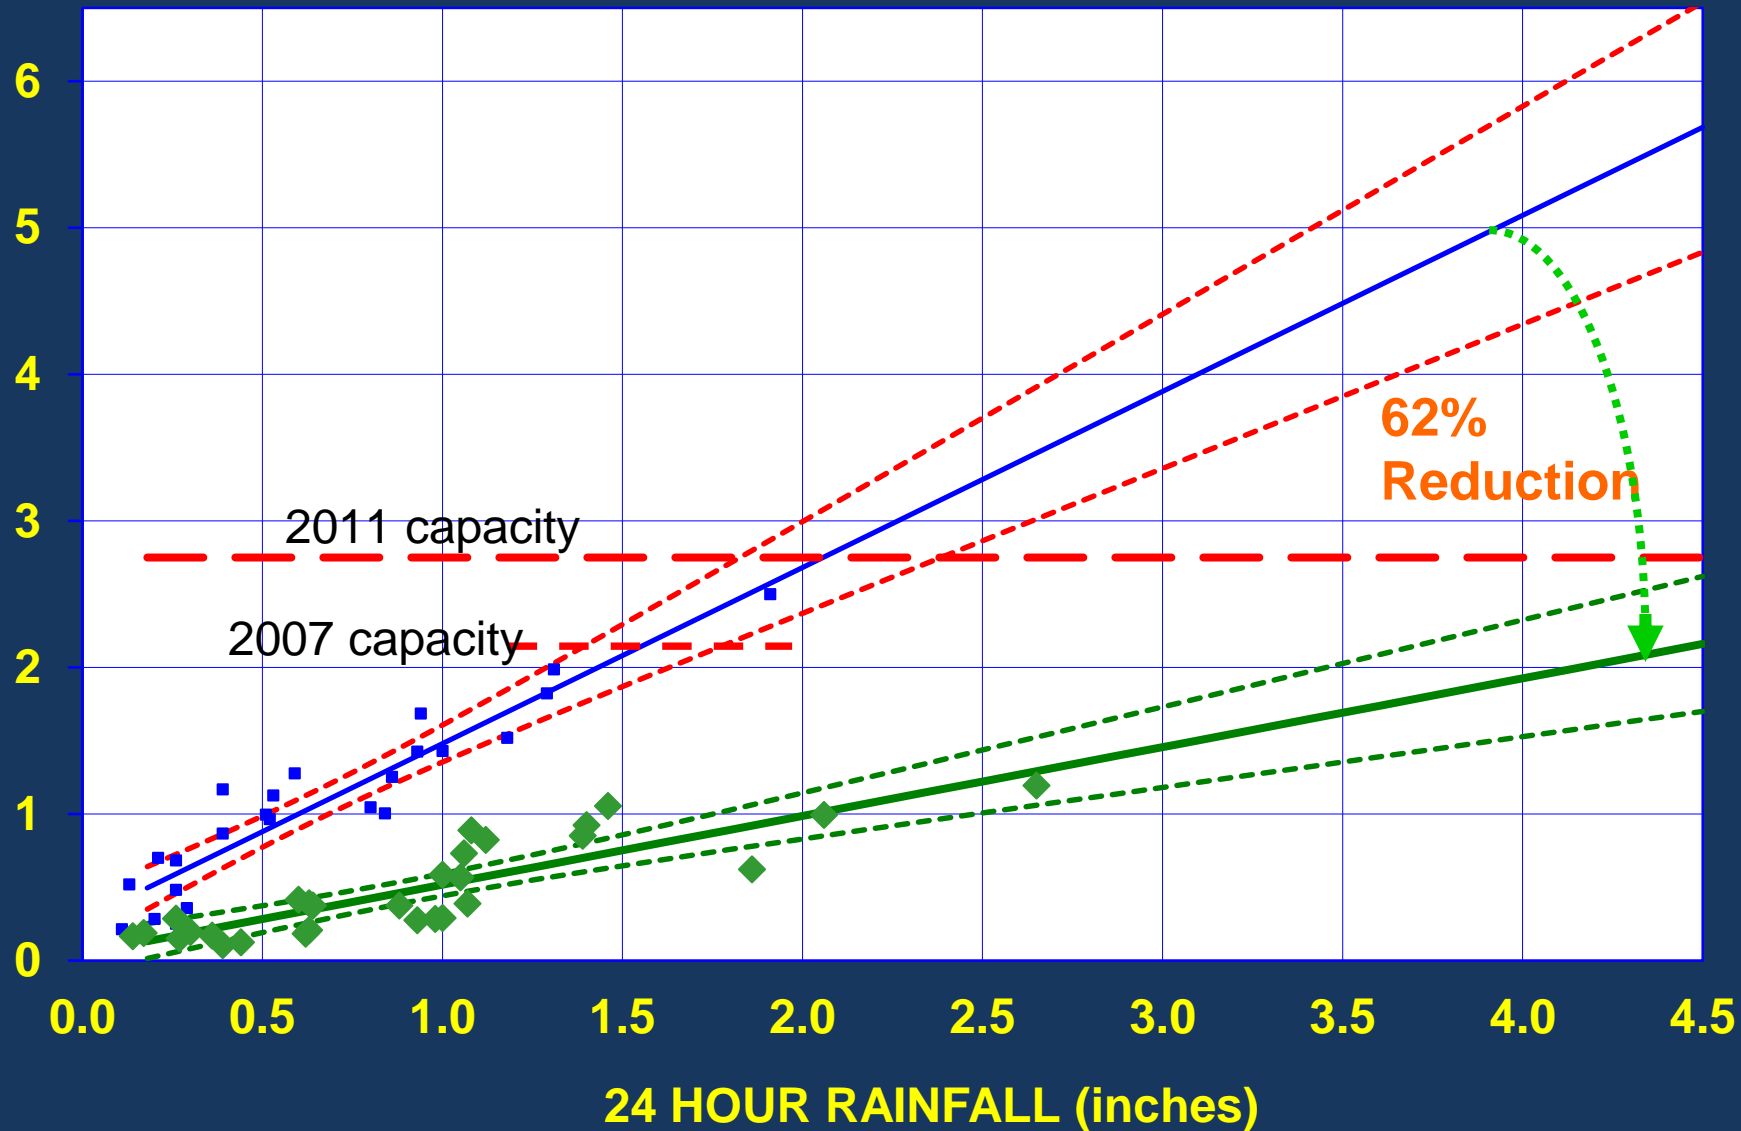

■ PEAK HOUR RAIN I/I

— PEAK HOUR BEST FIT LINE

— REMAINING CAP.(I/I)

- - - 95% CONFIDENCE

- - - 95% CONFIDENCE

◆ post peak

— post best fit

- - - post 95 up

- - - post 95 down

10 - CALCULATE O&M SAVINGS

- Possible 10-13 Year payback (on installation, design, investigation costs – TOTAL PROGRAM)
- Provides data for future program planning
- Accountability to community

- Brentwood is saving ~ \$1.6 million/year by eliminating 851 million gallons of I/I annually – pays for the program in 13 years

Successful Rehab Factors


- Extensive flow monitoring
- Lateral renewal to easement
- “Targeting” – lining selected by observed defects, age, proximity, migration potential, surface water
- Performance (air) test line and lateral

Questions ?

George Kurz, P.E., DEE
615-714-6120

George.kurz@comcast.net

www.sewercapacitymanagement.weebly.com

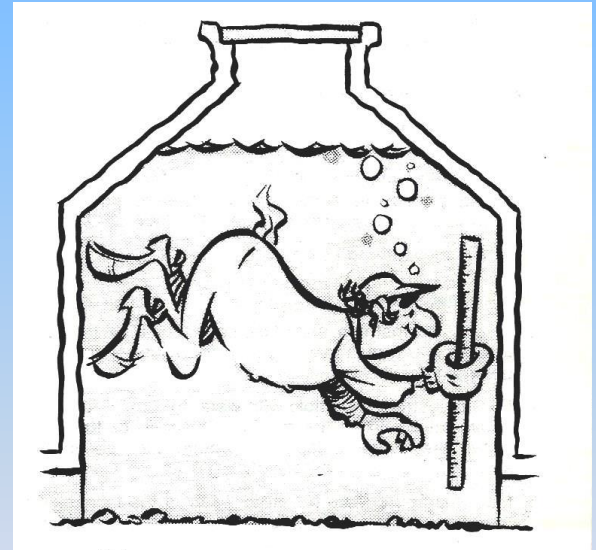

PROGRAM PAYBACK COMPARED TO O&M CHARGED

